




Schéma de branchement – Connexion diagram

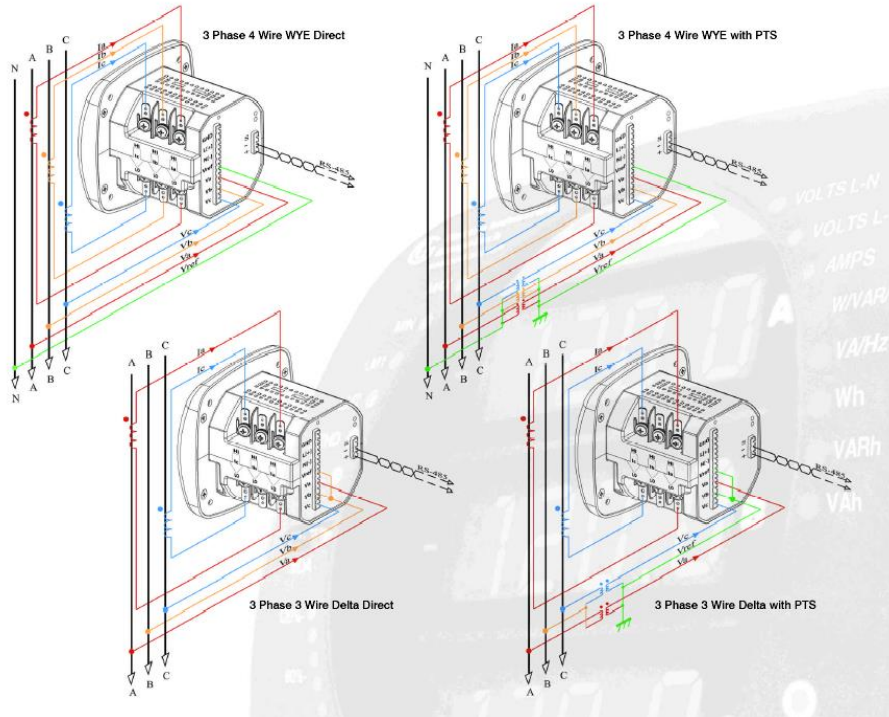

Information à fournir à la commande – Ordering Data

Appareil – Product

- | | |
|-------------------------------------|-------------------------------------|
| <input type="checkbox"/> SHARK 101 | <input type="checkbox"/> SHARK 102T |
| <input type="checkbox"/> SHARK 104 | <input type="checkbox"/> SHARK 103T |
| <input type="checkbox"/> SHARK 101T | |

Source auxiliaire – Auxiliary supply

- Type 1 : 24-48 VDC±10%DC.
- Type 2 : (90-265) V AC et (100-370) V DC.

Montage – Execution

SHARK 101 - 104

- ANSI C39.1 (cylindrique 4 ")
- Montage DIN IEC 92 (Carré)

SHARK 101/2/3T

- Rail Din 46277/3.

Calibre nominal – Rated input

- | | |
|---|------------------------------------|
| <input type="checkbox"/> In = 1A | <input type="checkbox"/> Fn = 50Hz |
| <input type="checkbox"/> In = 5A | <input type="checkbox"/> Fn = 60Hz |
| <input checked="" type="checkbox"/> 0-416 V Ph –Neutre / 0-721 V Ph –Ph | |

Demande spéciale – Special request _____

Quantité – Quantity _____

